

2023 Results	Contaminant	Violation	MCLG	MCL	Level Found and Range	Sample Sites & Frequency	Typical Source(s)
Regulated Contaminants	Total Coliform Bacteria	NO	0	Presence in ≤ 1 in 15 samples/mo.	TC+ & EC- On 06/12/23	15 per month throughout service area	Naturally present in environment
	Turbidity (NTU)	NO	TT	1 NTU max. & < 0.3 NTU 95% of time	High of 0.10 NTU 100% < 0.3 NTU	Continuously monitored at water plant	Soil runoff
	Total Organic Carbon (PPM = mg/L)	NO	TT	4 quarter avg. < 2.0 PPM or RR ≥ 1.0	RR range: 0.98 – 3.18 Min. RR: 1.00	Monthly	Naturally present in environment
Inorganic Contaminants	Barium (PPM = mg/L)	NO	2.0	2.0	0.018	Annually at water plant	Natural erosion of soil deposits
	Copper (PPM = mg/L)	NO	1.3	AL = 1.3	0.0433 90th percentile 100% ≤ AL	30 sites thru service area every 3 years	Corrosion of household plumbing
	Lead (PPB = µg/L)	NO	0.0	AL = 15	< 2.0 90th percentile 100% ≤ AL	30 sites thru service area every 3 years	Corrosion of household plumbing
	Fluoride (PPM = mg/L)	NO	4.0	4.0	Average: 0.70 Range: 0.61 – 0.86	3 - 4 / day at the water plant	Water additive to promote strong teeth
	Nitrate & Nitrite (PPM = mg/L)	NO	10.0	10.0	0.24	Annually at water plant	Septic tanks, soil erosion, sewage, and fertilizers
Disinfection Byproducts, Precursors, & Residuals	Trihalomethane Total (TTHMs) (PPB = µg/L)	NO	N/A	4 quarter site running avg. (4qrsa) < 80.0	Highest 4qsra: 52 Range: 10 - 79	Quarterly, at 4 locations in service area	By-product of drinking water disinfection
	Haloacetic Acids (HAA5s) (PPB = µg/L)	NO	N/A	4 quarter site running avg. (4qrsa) < 60.0	Highest 4qsra: 39 Range: 9 - 66	Quarterly, at 4 locations in service area	By-product of drinking water disinfection
	Chlorine (PPM = mg/L)	NO	MRDLG ≤ 4.0 & > 2.0	MRDL = 4.0	Highest avg. quarter: 2.2 Range: 1.5 – 2.9	15 per month throughout service area	Water additive to disinfect to control microbes

**Action Level (AL):** Concentration of a contaminant which, if exceeded, triggers enhanced treatment or other requirements which a water system must follow.

**Maximum Contaminant Level Goal (MCLG):** The “Goal”; the level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

**Maximum Contaminant Level (MCL):** The “Maximum Allowed”; the highest level of a contaminant allowed in drinking water. MCLs are set as close to MCLGs as feasible, using the best available treatment technology.

**Maximum Residual Disinfectant Level Goal (MRDLG):** Level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**Maximum Residual Disinfectant Level (MRDL):** Highest level of a disinfectant allowed in drinking water. The addition of a disinfectant is necessary for the control of microbial contaminants.

**Nephelometric Turbidity Unit (NTU):** Measure of water clarity. Turbidity over 5 NTUs is just noticeable to an average person.

**Parts / Billion (PPB) or Micrograms / Liter (µg/L):** Corresponds to one minute in 2,000 years or a single penny in \$10,000,000.

**Parts / Million (PPM) or Milligrams / Liter:** Corresponds to one minute in 2 years or a single penny in \$10,000.

**Removal Ratio (RR):** Ratio of actual quantity of a contaminant removed to the required quantity of a contaminant removed.

**Treatment Technique (TT):** A required process intended to reduce the level of a contaminant in drinking water.


Amherst County Service Authority  
PO Box 100  
Madison Heights, VA 24572-0100



## AMHERST COUNTY SERVICE AUTHORITY

113 Phelps Road / P.O. Box 100  
Madison Heights, VA 24572  
Phone: (434) 845-1605

## 2023 Drinking Water Quality and Consumer Confidence Report

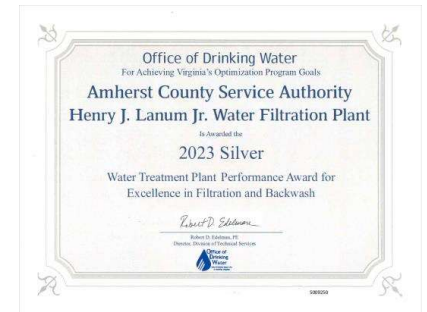

Virginia Dept. of Health Office of Drinking Water  
2023 Excellence in Waterworks  
Silver Performance and Operations Award

PRSRT STD  
US POSTAGE  
**PAID**  
MADISON HEIGHTS, VA  
PERMIT NO. 75

## Amherst County Service Authority (ACSA) 2023 Drinking Water Quality Report

ACSA is pleased to send you our 2023 Drinking Water Quality Report. ACSA's Board and staff want you to be informed about the excellent water and services we provide you each day. Our mission has always been to provide a safe and reliable supply of drinking water, meeting all State and Federal standards administered by the Virginia Dept. of Health (VDH). The purpose of this report is to inform you of our continued success in meeting these standards throughout 2023, which is demonstrated by ACSA receiving its 12th consecutive (and 14<sup>th</sup> in 16 years) annual VDH Waterworks Performance Excellence Award. The 2023 Silver award is our fifth Silver, and fourth consecutive; we received our first in 2015.

If you have questions about this report, wish to know more about any aspect of your drinking water, or want to know how to participate in the decisions that may affect water quality, please contact the ACSA Executive Director at 434-845-1605. Regularly scheduled meetings of the ACSA Board are held at 1:30 pm the first Tuesday of the month at the Amherst County Administration Building, 153 Washington St., Amherst, VA. We welcome your attendance.

ACSA's public drinking water supply originates from two sources: Graham Creek Reservoir and Harris Creek. The watersheds supplying these sources are located solely in Amherst County. VDH's 2003 Source Water Assessment (available by calling the phone number above) classifies surface water sources as highly susceptible to contamination. This does not mean either of our water sources has ever been, or ever will be, contaminated beyond the purification capability of ACSA's highly trained operational staff and high performance water treatment technology, both of which consistently earn excellent reviews during annual VDH inspections. To facilitate excellent raw water quality, ACSA has one of the nation's most rigorous Water Supply Watershed Protection Programs. As a result of promotion of best management practices, local regulation of land use activities, and ACSA owning adjacent properties to buffer the raw water sources, the ACSA Program has received national recognition twice from the Environmental Protection Agency

(EPA) for preservation and enhancement of source water quality for potable treatment.

The Henry L. Lanum, Jr. Water Filtration Plant is a conventional rapid sand filtration facility with a production capacity of 2 million gallons per day. Approximately 170 miles of water distribution mains transport our high-quality finished water to 4 strategically located water storage tanks and to, 7,102 service connections (Dec. 2023 figure).

Sources of drinking water (tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the land surface or through the ground, it dissolves naturally occurring minerals (in some cases, radioactive material) and organic matter, and can pick up substances resulting from the presence of animals or human activity. Contaminants that may be present include:

- \* Microbial impurities (viruses, bacteria, etc.), which may develop at agricultural livestock operations; septic systems, sewage treatment plants; and other sources;
- \* Inorganic contaminants (salts, metals, etc.) which can be naturally occurring or result from urban stormwater runoff; farming; industrial or domestic wastewater discharges; oil or gas production mining; and other sources;
- \* Pesticides and herbicides, which may come from a variety of sources, such as agriculture, urban stormwater runoff, and residential uses;
- \* Naturally occurring or manufactured organic chemical contaminants, including synthetic and volatile organic chemical byproducts of industrial processes and petroleum production, gas stations, urban and roadway stormwater runoff, septic systems, and other sources;
- \* Radioactive contaminants, naturally occurring or the result of oil and gas production or mining activities.

To ensure tap water is safe to drink, EPA and VDH publish regulations which regulate and limit the levels and amounts of certain impurities in water provided by public water systems for human use. U.S. Food and Drug Administration rules establish limits for contaminants in bottled water, which must provide the same public health protection.

ACSA samples and conducts over 140 tests each day at the Lanum water plant for pollutants that

could potentially contaminate our water supply. Additionally, over 180 offsite compliance tests of ACSA's raw and finished water are conducted each year by an independent testing laboratory operated by the Commonwealth of Virginia.

The table on the other side of this narrative summarizes our monitoring results from January 1 to December 31, 2023. All drinking water, including bottled water, may be reasonably expected to contain at least small amounts of some contaminants. It is important to remember that presence of these impurities does not necessarily indicate a health risk. More information about contaminants and potential health effects can be obtained from the EPA Safe Drinking Water Hotline at 1-800-426-4791.

The table lists only contaminants that had some level of detection. Tests were also run for many other potential contaminants which were shown not to be present. The ACSA Board and staff take great pride in providing drinking water which consistently meets or exceeds all rigid State and Federal drinking water quality standards.

Maximum Contaminant Levels (MCLs) are set at very stringent levels by EPA. In developing the standards, EPA assumes that the average adult drinks 2 liters of water each day during a 70 year life span. EPA generally sets MCLs at levels that will result in no adverse health effects, or a one-in-ten-thousand to one-in-one-million chance of having the described health effects. **The EPA has determined that your water is safe at these levels.**

Some people may be more vulnerable to even minimal contaminants in drinking water than the general population. Immuno-compromised individuals, such as persons with cancer that are undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, infants, and some elderly, can be particularly at risk. These persons should seek advice about drinking water from their health care providers. EPA and the Centers for Disease Control have established guidelines on appropriate means to lessen the risk of infection from *Cryptosporidium* and other microbiological contaminants for vulnerable persons. This information is available

from the EPA Safe Drinking Water Hotline.

Copper and lead in the environment is another concern. **ACSA's drinking water supply does not contain elevated levels of copper or lead.** However, these metals can leach into the water from private service lines or household plumbing. Of 30 ACSA finished water samples collected in 2021 (required every 3 years), only **2** showed a detectable concentration of lead, and **both** were far below the EPA Action Level (AL). Of 30 other similar samples, only **10** showed detectable levels of copper, all far below the AL (refer to the table). Still, the following information may be useful.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water primarily originates from materials and components associated with private service lines and home plumbing. ACSA is responsible for providing high quality drinking water, but has no control over the variety of materials used in private plumbing. When your water has been sitting for several hours, you can minimize any potential for lead exposure by flushing your tap for 15 to 30 seconds, or until it becomes cold or reaches a steady temperature, before using it for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, test methods, and steps you can take to minimize exposure, is available from the EPA Safe Drinking Water Hotline at 1-800-426-4791 or at <http://www.epa.gov/safewater/lead>.

Some people who drink water containing trihalomethanes (THMs) or haloacetic acids (HAA5s) in excess of the MCLs over many years could experience liver, kidney, or central nervous system problems, and may have an increased risk of getting cancer. **But ACSA's drinking water supply consistently does not contain elevated levels of THMs or HAA5s.**

Thank you for allowing ACSA to provide clean, reliable, high quality drinking water to you and your family in 2023. Our staff works around the clock to maintain this quality and your trust. We ask our customers to help us protect our water resources, which are the heart of our community, our way of life, and our children's future.